




Job Name:	
Job Location:	
Engineer:	
Contractor:	
Tag:	
PO#:	
Rep:	
Wholesale Dist.:	

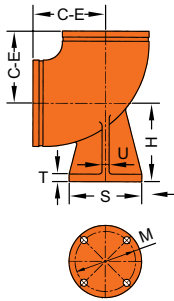

Model 7110-B is a ductile iron 90° grooved-end elbow with base support, designed for installation at the bottom of a riser system. An anchor can be placed in conjunction with the base support to support the weight of the pipe, coupling and fluid.

Shurjoint standard fitting pressure ratings conform to the ratings of Model 7707 couplings.

For Fire Protection pressure rating, listing, and approval information, refer to Data Sheet B-42 or visit [www.shurjoint.com](http://www.shurjoint.com) for details or contact Shurjoint.

## DIMENSIONS

NOMINAL SIZE	PIPE O.D.	DIMENSIONS						WEIGHT
		C - E	H	U	T	S	M	
in	in	in	in	in	in	in	in	lb
mm	mm	mm	mm	mm	mm	mm	mm	kg
3	3.500	4.25	4.88	0.50	0.56	5.00	3.88	10.5
80	88.9	108	124	13	14	127	99	4.8
4	4.500	5.00	5.50	0.50	0.62	6.00	4.75	15.2
100	114.3	127	140	13	16	152	121	6.9
6	6.625	6.50	7.00	0.62	0.69	7.00	5.50	26.3
150	168.3	165	178	16	18	178	140	11.9
8	8.625	7.76	8.38	0.88	0.94	9.00	7.50	56.9
200	219.1	197	213	22	24	229	191	25.8
10	10.750	9.02	9.75	0.88	0.94	9.00	7.50	88.9
250	273.0	229	248	22	24	229	191	40.3
12*	12.750	10.00	11.25	1.00	1.00	11.00	9.50	70.4
300	323.9	254	286	25	25	279	241	32.0

## MATERIAL SPECIFICATIONS

### FITTING BODY:

- Ductile Iron castings to ASTM A536, Gr. 65-45-12 and or to ASTM A395, Gr. 65-45-15, min. tensile strength 65,000 psi (448 MPa).

### SURFACE FINISH:

- Standard painted finishes in orange or RAL3000 red.
- Hot dip galvanized (optional)
- Epoxy coatings in RAL3000 red or other colors (optional)

## GENERAL NOTES

- Maximum Working Pressure (CWP) listed is the maximum cold water pressure for general piping services tested to ASTM F1476 and or AWWA C606 methods. Figures listed are based on roll- or cut-grooved standard wall carbon steel pipe. For other pipe schedules or pipe materials, contact Shurjoint for additional information.
- Max. End Load is calculated based on the maximum working pressure (CWP).
- Listed and or Approved Pressures are pressure ratings for fire protection systems, tested and approved by various approval bodies. Please always refer to the latest approval data posted on the Shurjoint website.
- Field Joint Test: For one time only the system may be tested hydrostatically at 1.5 times the maximum working pressure listed (AWWA C606 5.2.3).
- Warning: Piping systems must always be depressurized and drained before attempting disassembly and or removal of any components.
- The 10 Year Limited Warranty applies to manufacturing defects only and does not cover severe service/temperature applications or wear parts.
- Shurjoint reserves the right to change specifications, designs and or standard without notice and without incurring any obligations.